


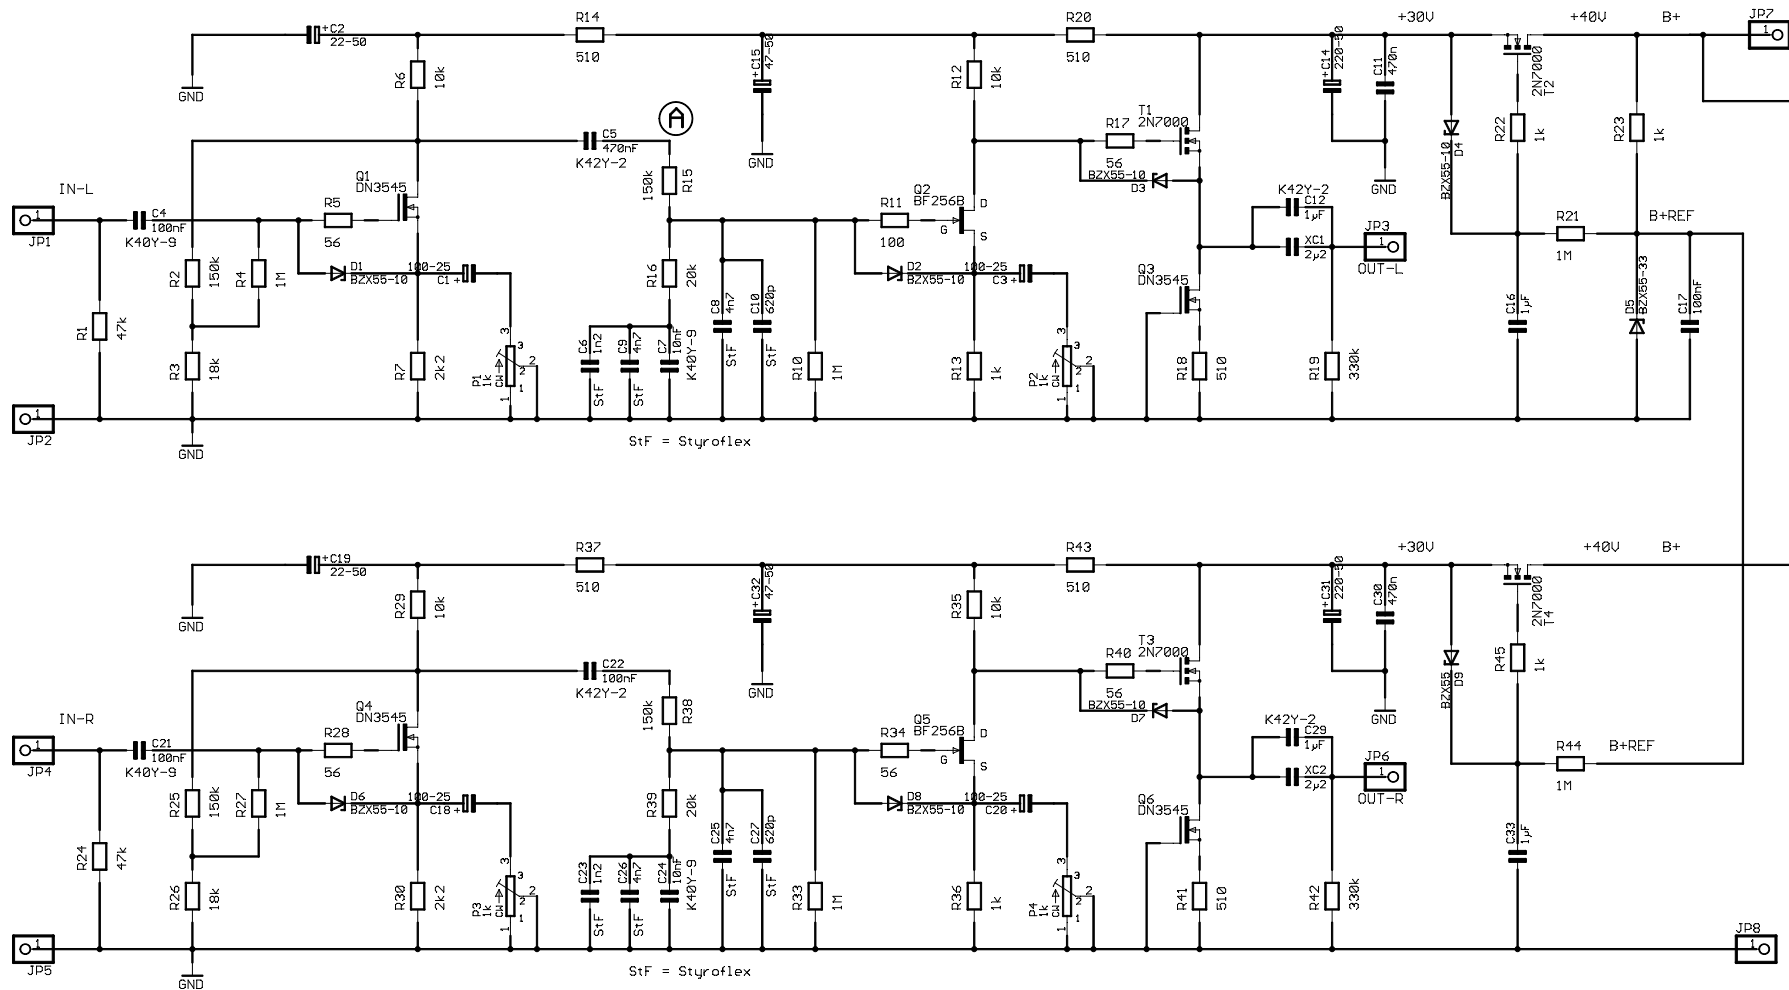

Adjustment (set P1 first!):

Input → 10mVrms ...1kHz sinewave

@ P1 → A → 275mVrms

@ P2 → Output → 600mVrms

R23: For B+ = 40V → 1k
45V → 1k8
48V → 2k2

TUBECLINIC

LINZ/AUSTRIA

TITLE: _CHARDONNAY-SST

Document Number:

2109-001 BEG

REV:
V1.3

Date: 15.09.2022 19:40:02

Sheet: 1/1

